




Uspešno pogašen požar v kompenzacijski omarici trafo postaje TP5 - JULON, dne 17.05.2007



Stanje pred in po požaru

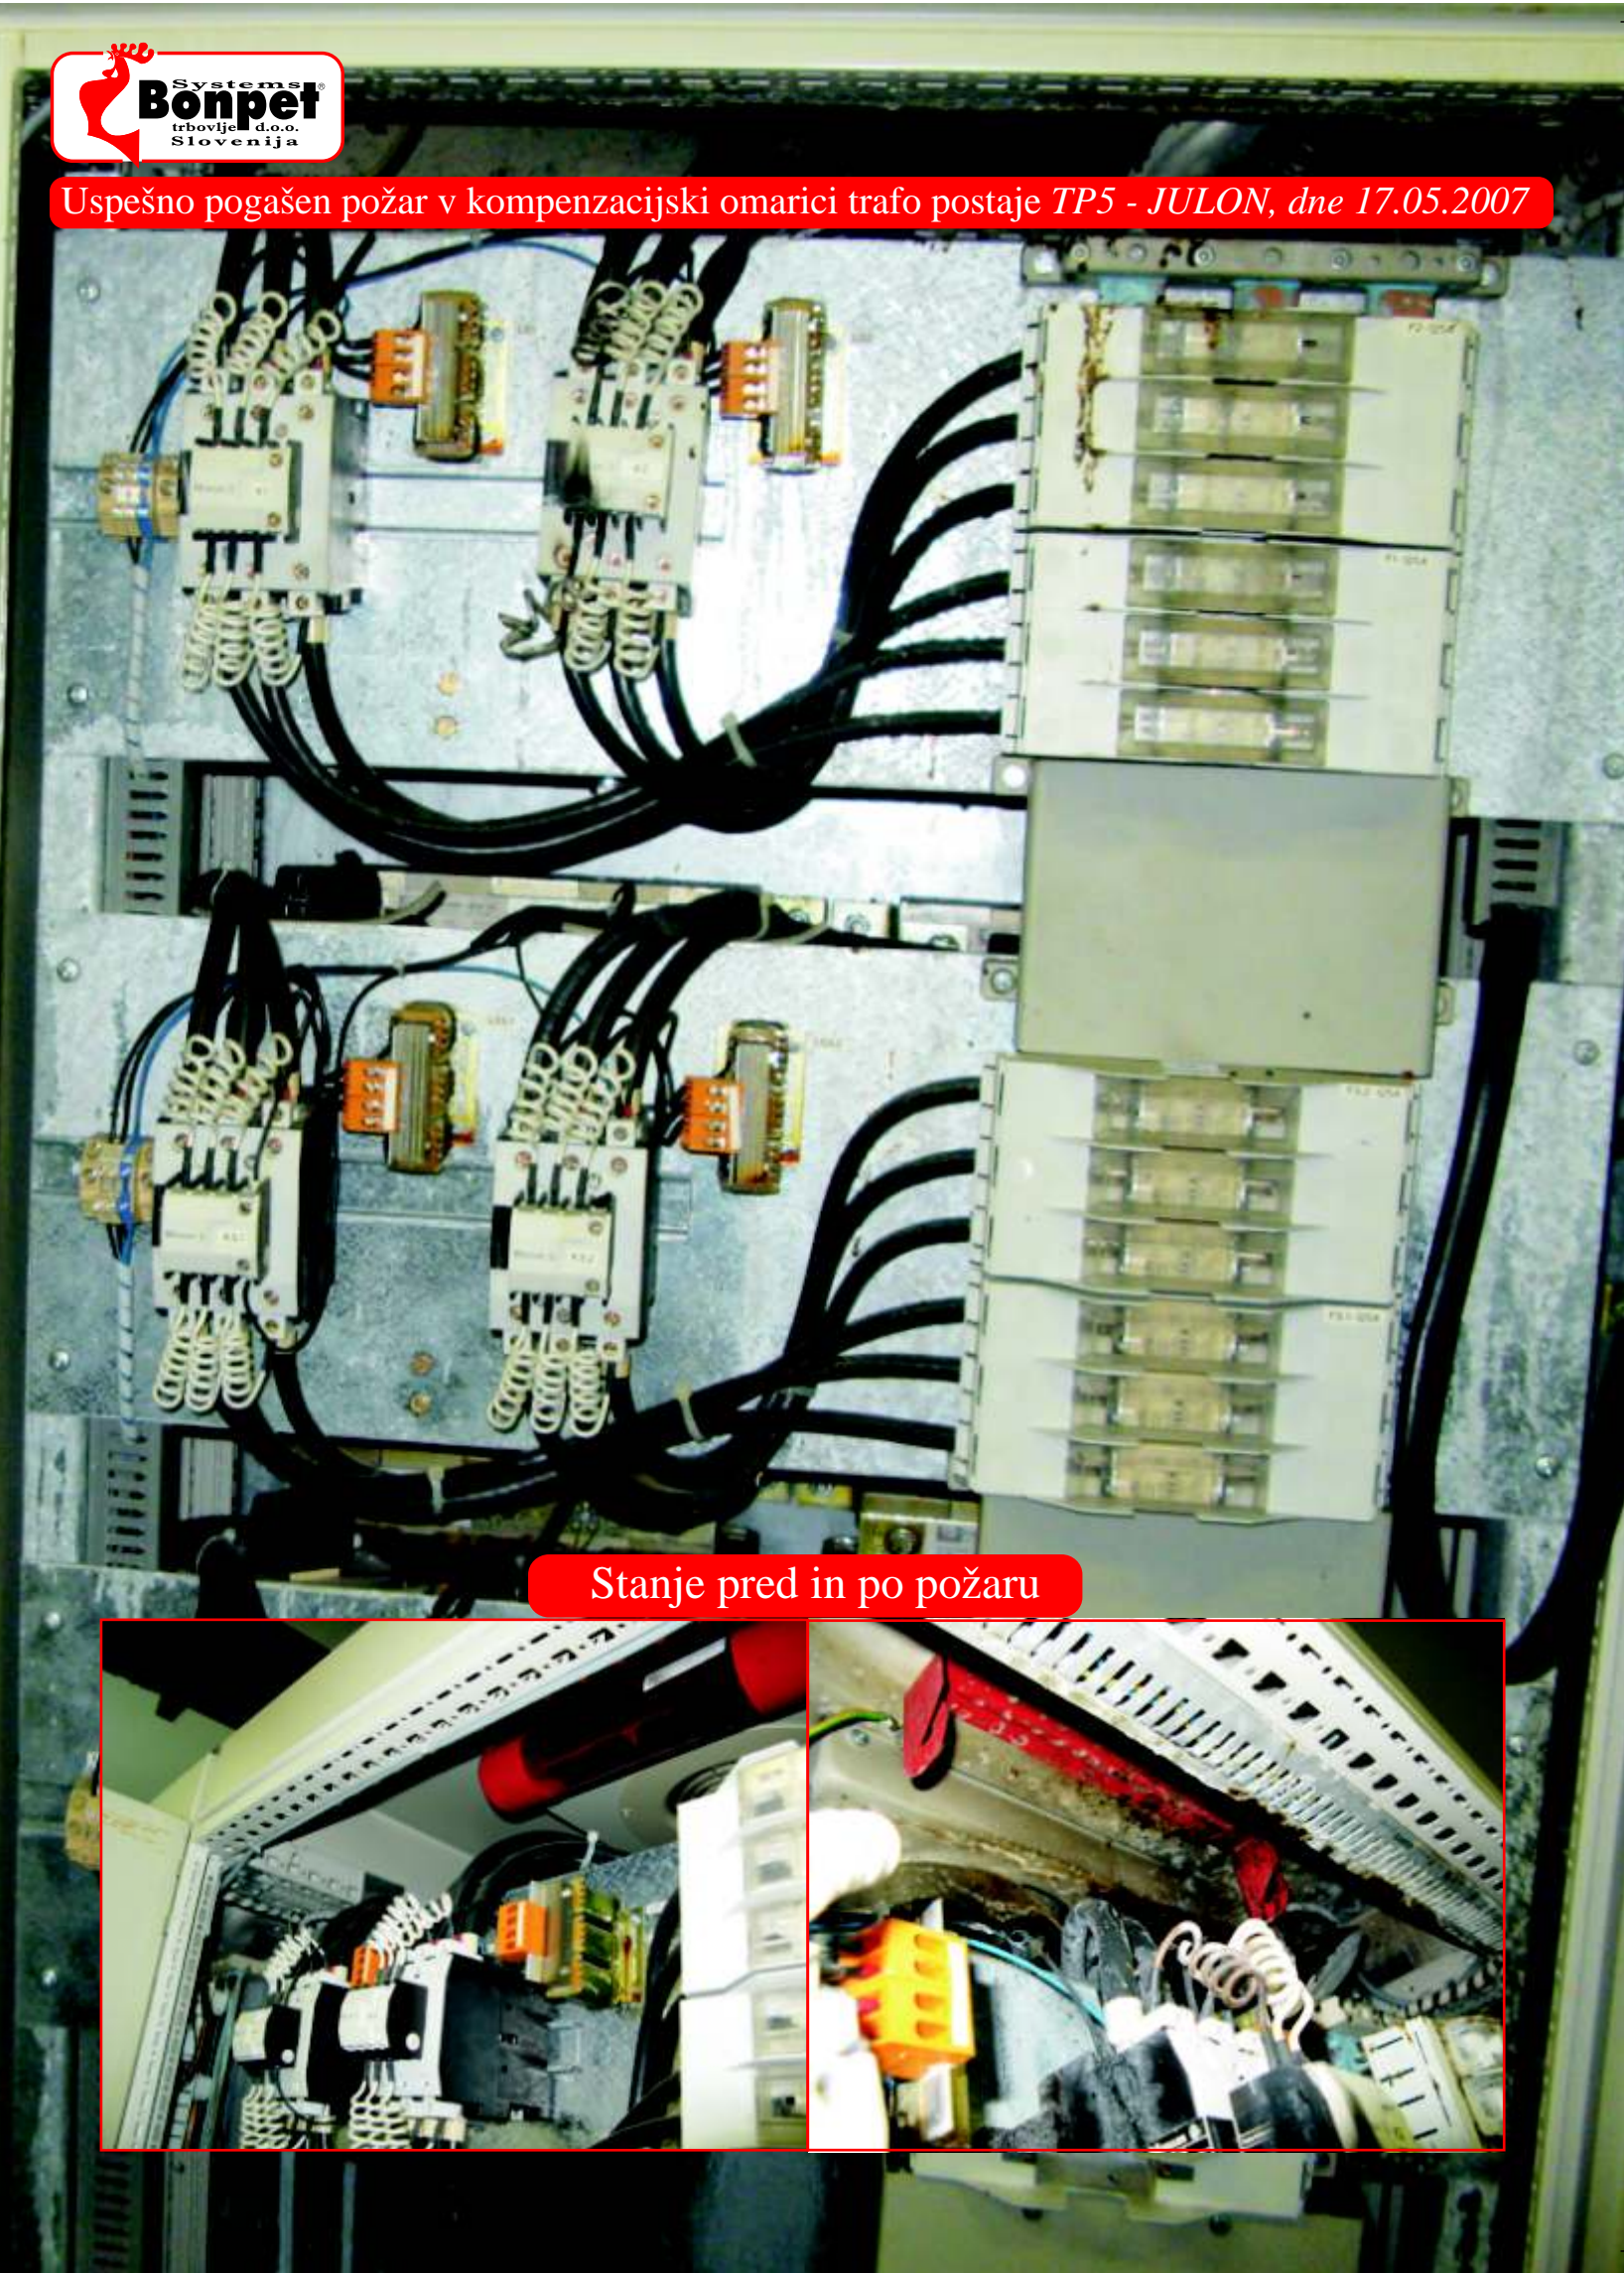

GRUPPO BONAZZI SINCE 1956
1001 Ljubljana, Letališka c. 15, SLOVENIJA P.P. 4032
Telephone +386 (0)1 58 42 200
Fax - sales department +386 (0)1 54 02 270
Fax - purchasing department +386 (0)1 58 42 360



Company: Julon d.d., Letališka 5, LJUBLJANA

CONFIRMATION ABOUT THE SUCCESSFUL FIRE EXTINGUISHING WITH FIRE EXTINGUISHER BONPET

Event: The fire at armoire at trafo station TP5- JULON 1

Description of the operation:

Extinguishing ampoule Bonpet was installed on the top of the armoire and has activated next to ignition of the elements- capacitors and cables. High temperature at the ignition caused the activation of the ampoule Bonpet. With its activity ampoule Bonpet caused the minimalization of the fire damage and that is why component parts of the armoire stayed intact.

From the enclosed photos could be seen how ampoules Bonpet were installed before the activation.

Ampoule Bonpet has successfully done it's work and prevent spreading the fire round other electrical armoires.

Enclosed:

- photo

Confirmed by:

JULON d.d.
Mladen Bozanic, univ. dipl. inž.kem.
Letališka 5

Ljubljana, 17.05.2007

